


# Remote C.T. Cabinet

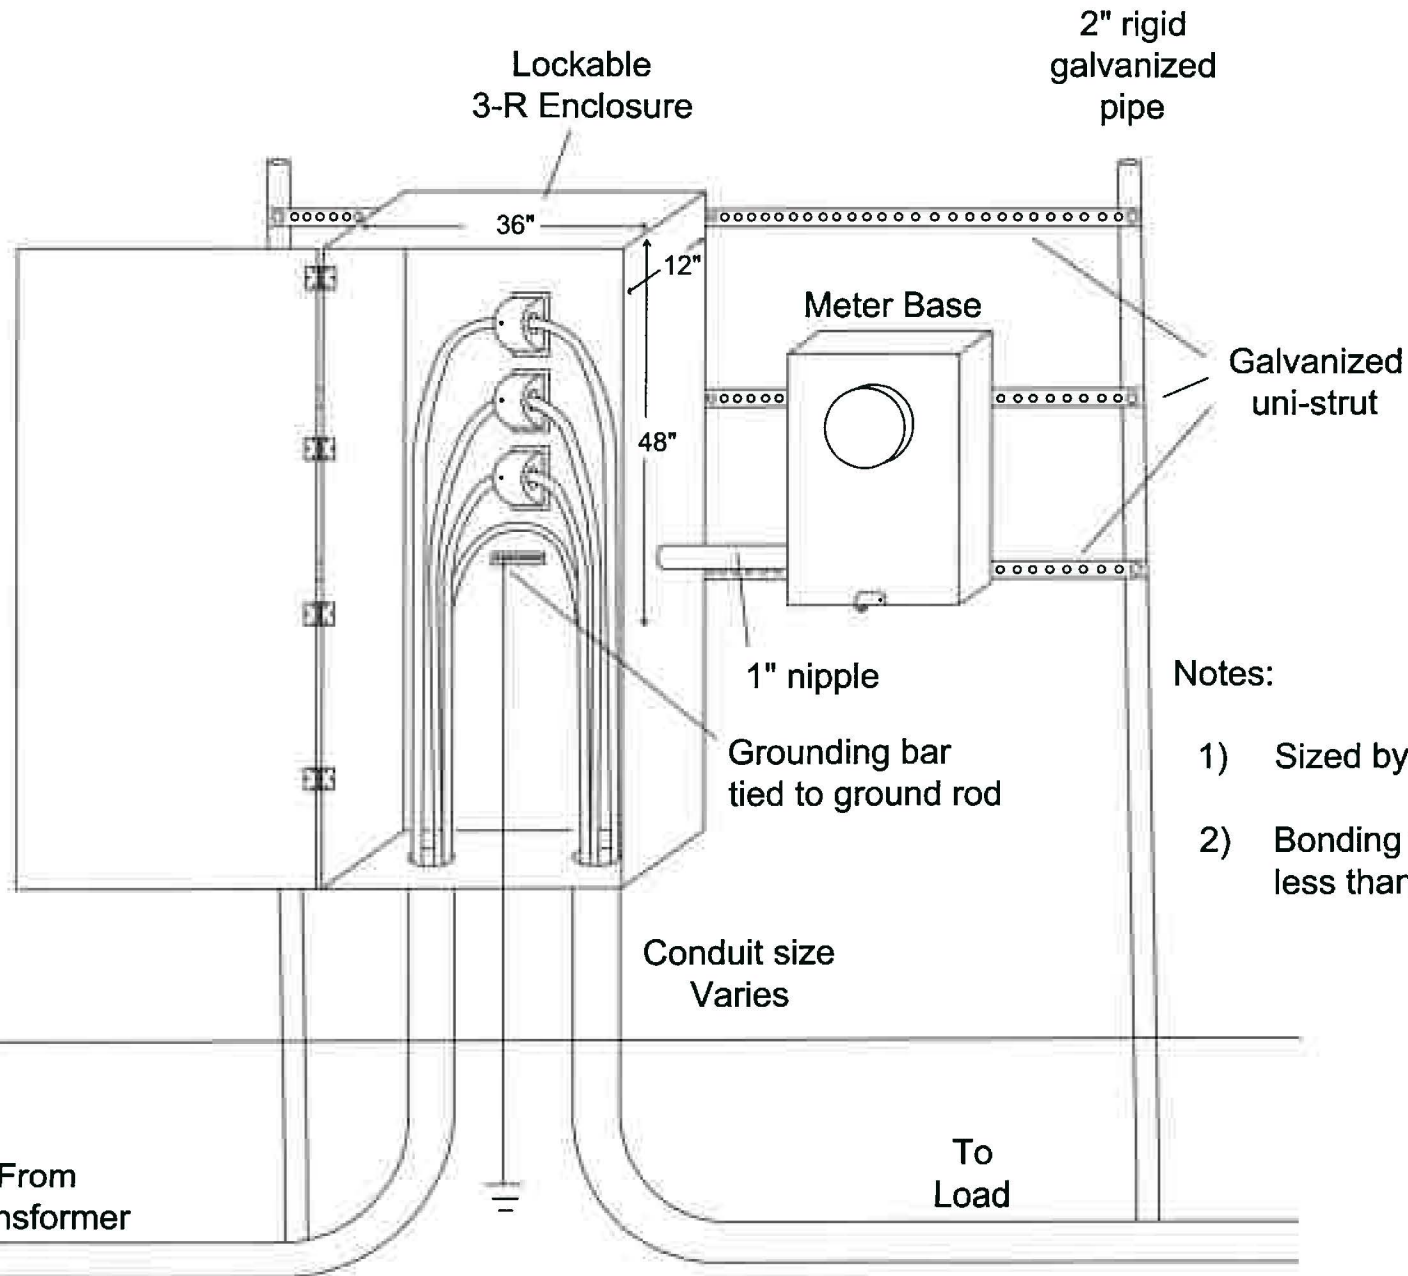

## Notes:

- 1) Sized by NEC and local governing body
- 2) Bonding wire to extend to PEI if structure is less than 6' from transformer.